


- KEY DATES -

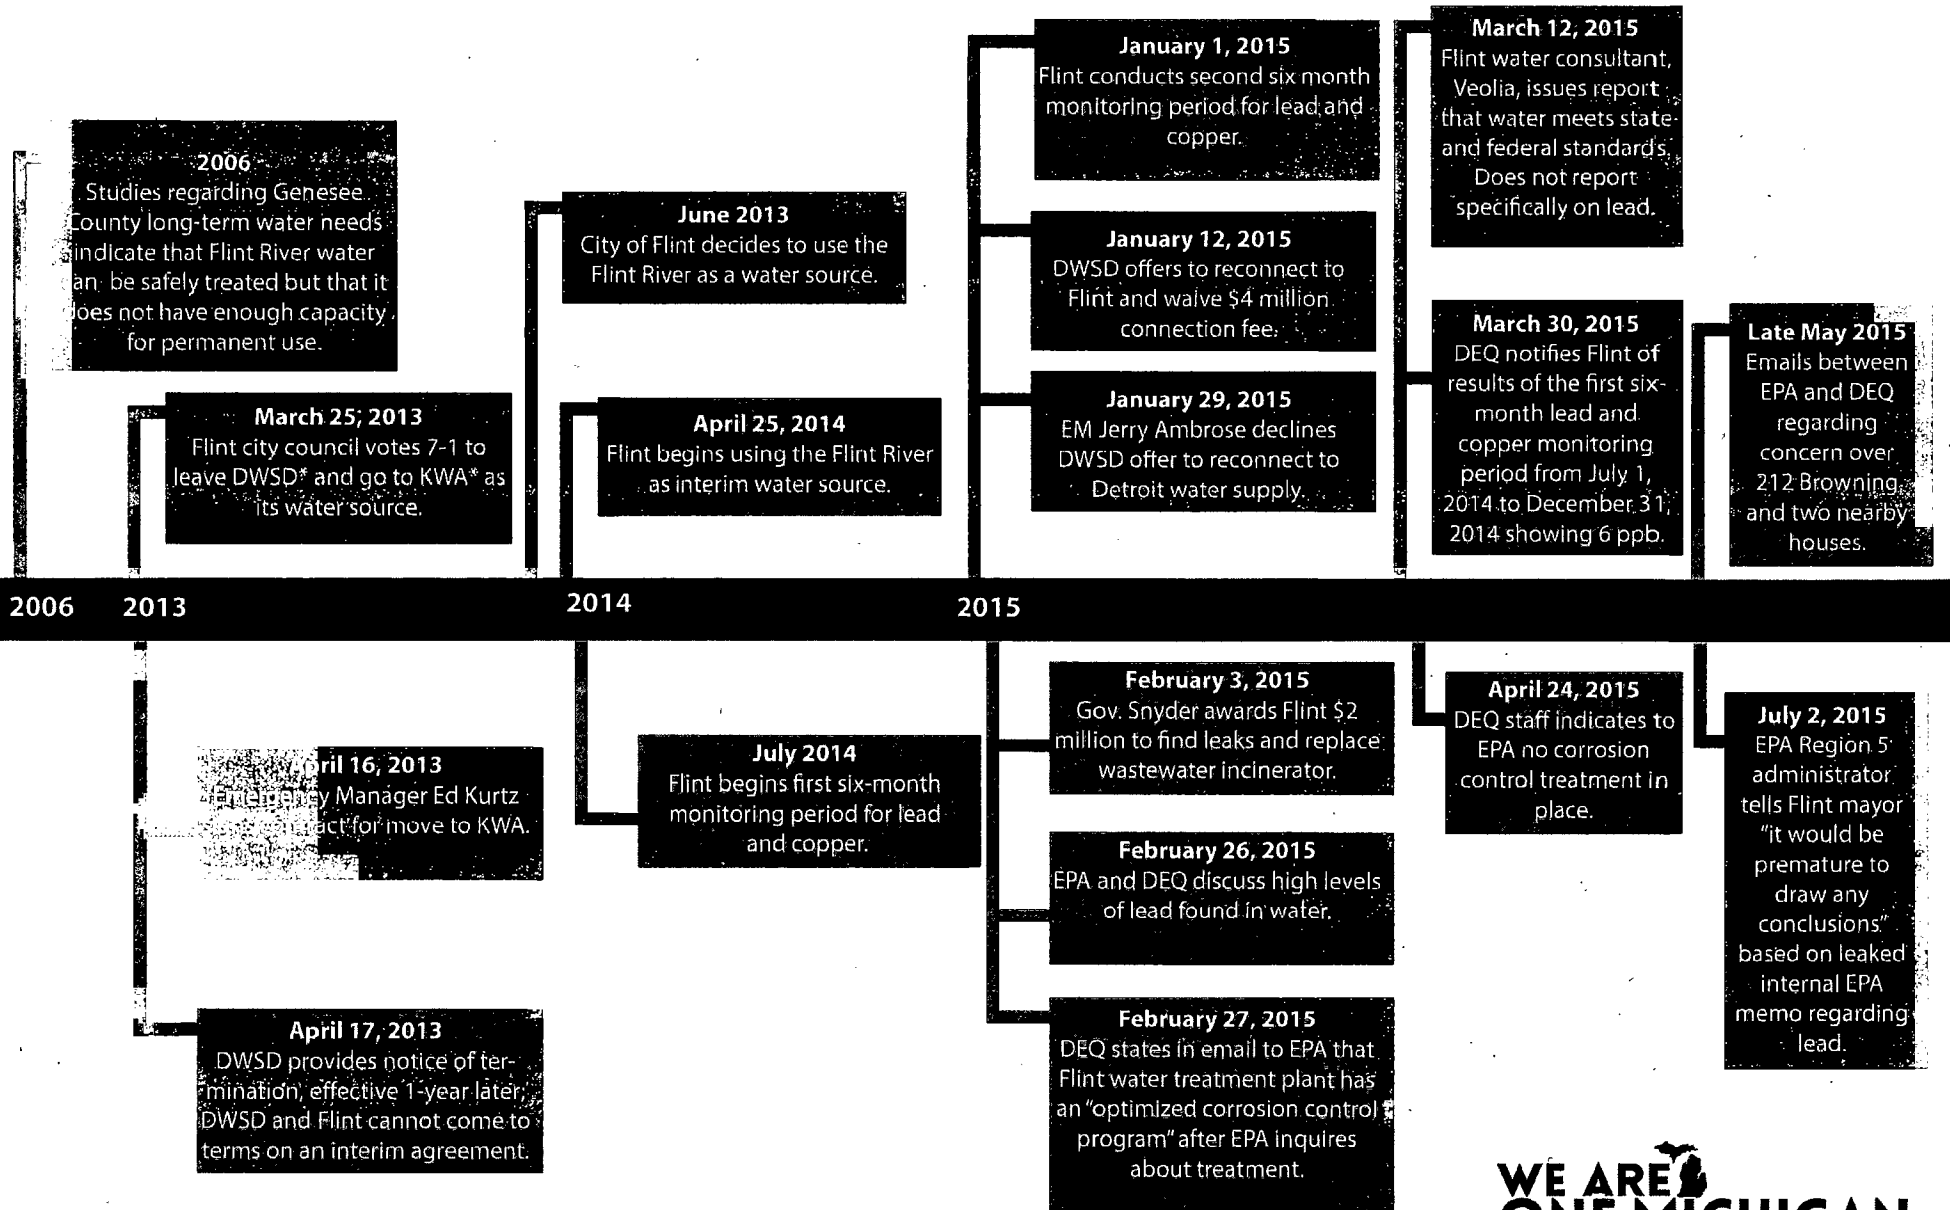

* DWSD: Detroit Water and Sewage Department

* KWA: Karengodi Water Authority

- TIMELINE CONTINUED -

July 21, 2015
EPA and DEQ discuss the requirement for corrosion control optimization of drinking water from Flint River.

July 22, 2015
Governor Snyder's Chief of Staff Dennis Muchmore emails DHHS director, Nick Lyon, stating community concerns about lead in the water. Muchmore asks about Flint water test results, blood testing and State's response.

September 2, 2015
Professor Edwards communicates that the corrosiveness of Flint water is causing lead to leach into residents' water through pipes.

Early September 2015
DEQ disputes Professor Edwards' test results and conclusions about corrosion and lead leaching.

September 28, 2015
DEQ and DHHS Directors provide briefing to Gov. Snyder on potential scope and magnitude of the issue. DHHS continues to review blood lead level data.

October 19, 2015
DEQ Director Dan Wyant states: *"Staff made a mistake while working with the City of Flint. Simply stated, staff employed a federal (corrosion control) protocol they believed was appropriate and it was not."*

November 3, 2015
The EPA indicates differing possible interpretations of the Lead and Copper Rule with respect to how the LCR's optimal corrosion control treatment procedures apply to this situation (new water source/new water treatment).

January 4, 2016
Genesee County Commission votes to declare emergency.

January 5, 2016
Gov. Snyder declares emergency for Genesee County, activating the State Emergency Operations Center.

January 9, 2016
MSP Emergency Management Division announces water resource sites established in Flint with bottled water, filters and testing kits.

January 8, 2016
Gov. Snyder and Flint Mayor Weaver meet to discuss collaboration.

2015

2016

August 17, 2015
Based on July results showing lead levels at 11 ppb from the second six-month testing period from January 1, 2015 to June 30, 2015, DEQ instructs Flint to optimize corrosion control.

August 23, 2015
Virginia Tech researcher Prof. Marc Edwards raises concerns about corrosion and lead. Confirms DEQ that he will be studying Flint's water quality issues.

August 28, 2015
Concerned Pastors announce water filter giveaway in Flint.

October 1, 2015
DHHS confirms lead problem. City of Flint urges residents to not drink water.

October 2, 2015
Governor releases 10-point plan to address water system, \$1 million for water filters, and anticorrosion treatment.

October 8, 2015
Governor announces plan to reconnect to Detroit water and Flint develops the plan.

October 15, 2015
Gov. Snyder signs supplemental appropriation with \$9.35 million to assist Flint in reconnecting to DWSD. Mott Foundation contributed \$4 million and Flint \$2 million.

October 16, 2015
City of Flint reconnects with DWSD.

December 9, 2015
Flint begins to add additional corrosion controls.

December 14, 2015
City of Flint declares emergency.

December 29, 2015
Gov. Snyder takes action on initial findings from Flint Water Task Force, DEQ Director Wyant and Communications Director Brad Wurfel resign.

December 30, 2015
Gov. Snyder taps DNR Director Keith Creagh to guide DEQ through leadership transition.

January 11, 2016
Gov. Snyder signs Executive Order to create the Flint Water Interagency Coordinating Committee to work on long-term solutions to the Flint water situation.

January 12, 2016
Governor requests FEMA's assistance and activates Michigan National Guard to help with water resources distribution.

January 14, 2016
Governor requests Presidential declaration of major disaster and emergency and requests federal aid.

January 16, 2016
The President approves declaration of emergency and request for federal aid. The president denies request for a declaration of major disaster.