


Impact Monitoring: Public Water System Testing

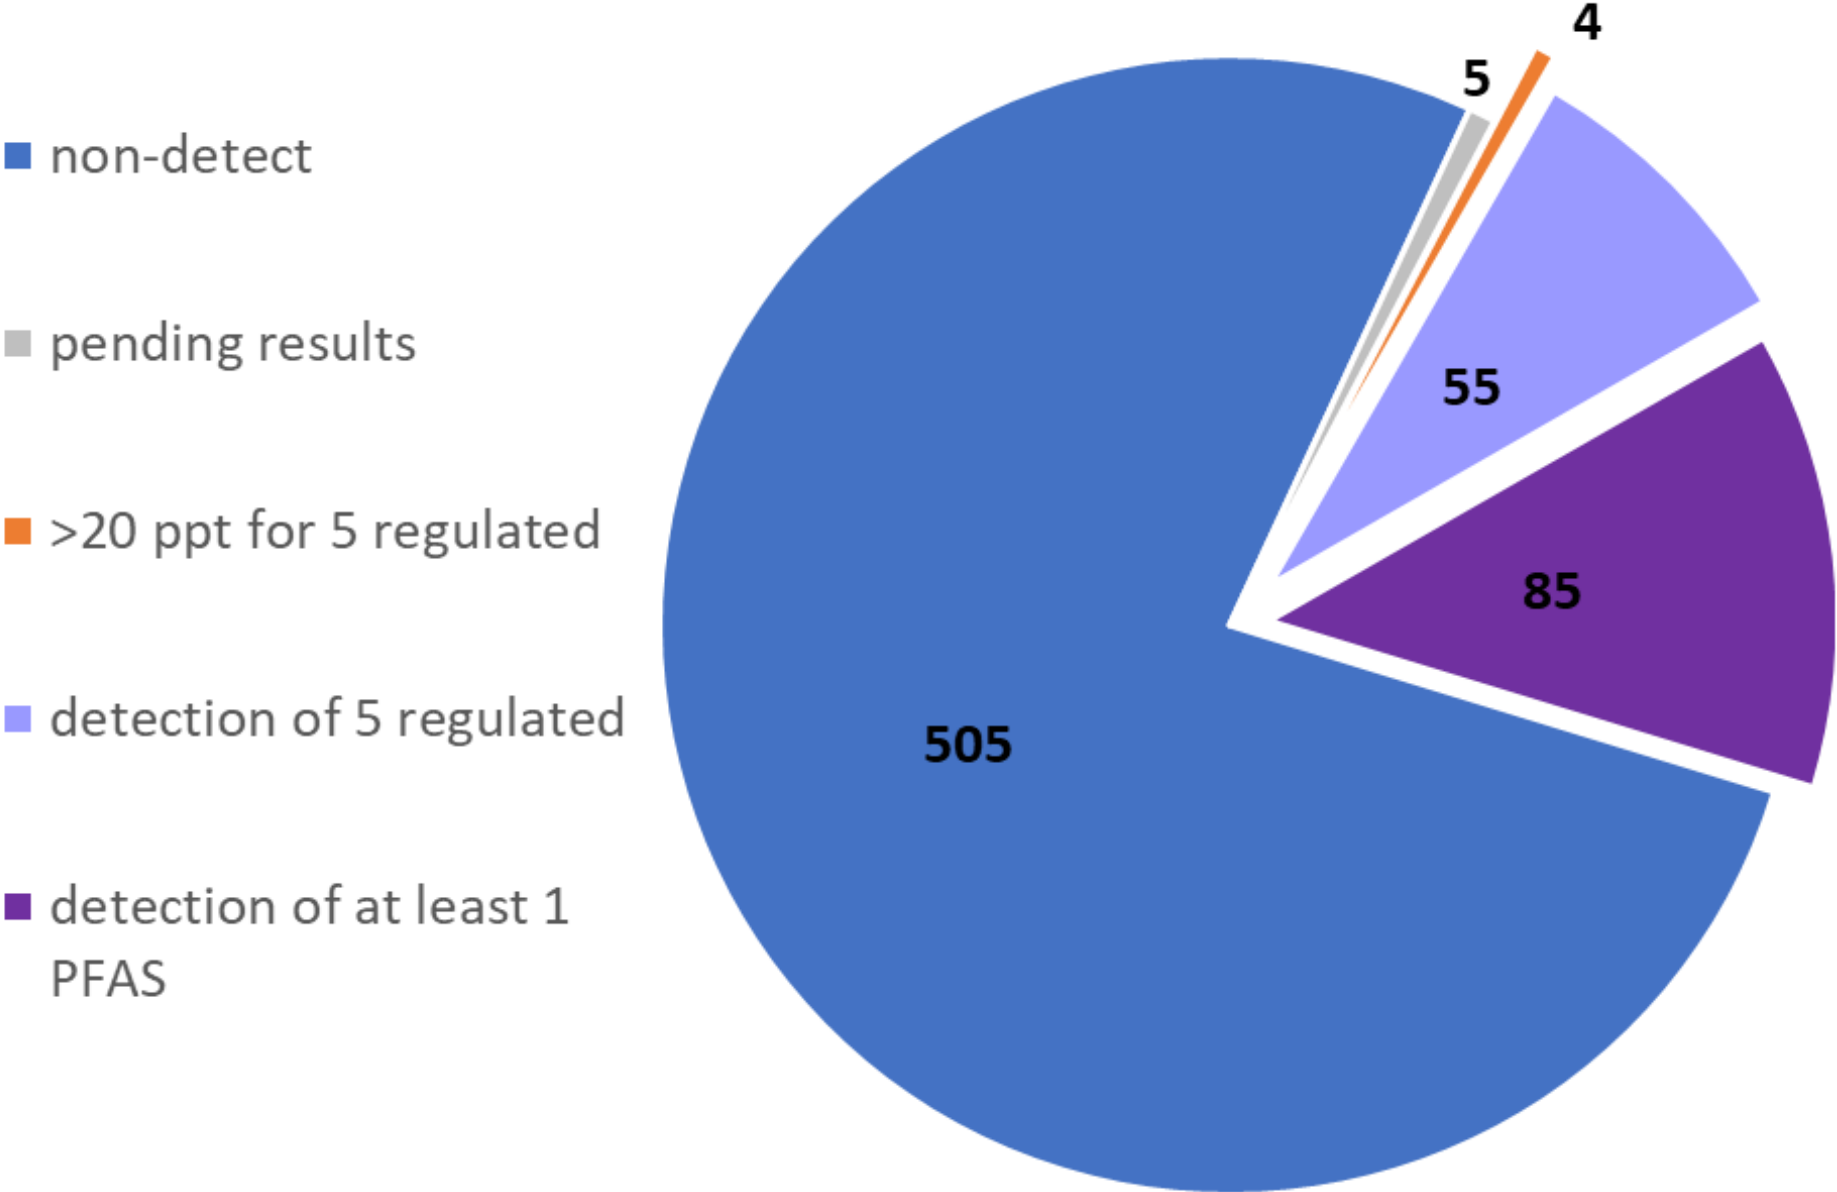

Impacted Public Drinking Water Systems

Do Not Drink Notice Required

- Mount Holly School
- Thetford Academy
- Killington Mountain School
- Fiddlehead Condominiums

Results between 15 - 20 ppt

- Kids in the Country*
- Craftsbury Fire District 2
- Windy Hollow Mobile Home Park
- Mountainside Resort (Stowe)
- Snowtree Condominium (Dover)

Elevated, but unconfirmed as of 2/13/20

- Killington Village Inn
(formerly Killington School of Resort Management)

* = confirmed below 20 ppt